



8 7 6 5 4 3 2 1

H
G
F
E
D
C
B
A

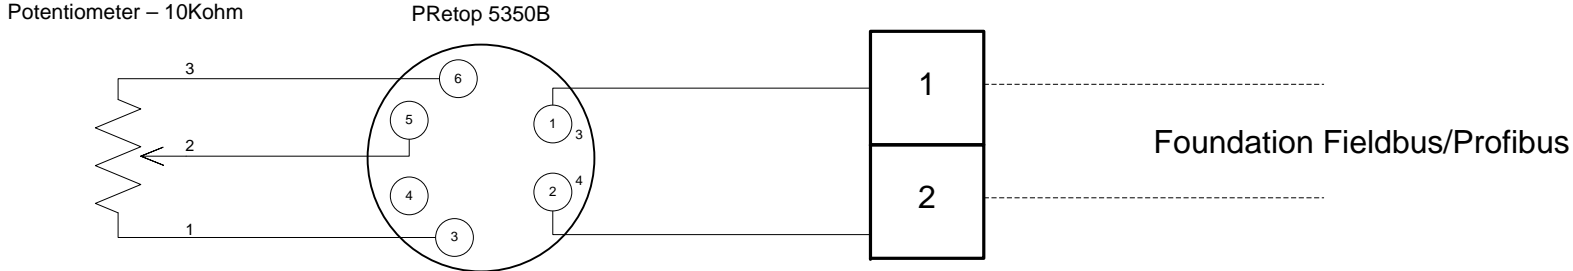

Important!
 All gland holes must be fitted with fitting cable glands.
 Unused gland holes are closed with fitting plugs, in order to maintain the degree of protection.

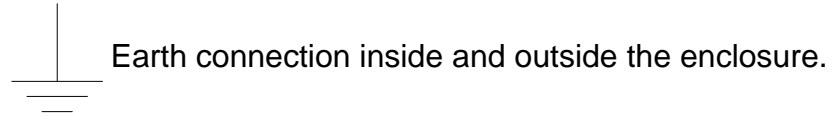

----- Wiring by customer

4				
3				
2				
1	28-09-09	CT		First edition
REV.	DATE	DESIGN	APP.	REVISION NOTES



Val Controls A/S
 Limfjordsvej 3 • DK-6715 Esbjerg N
 Tel. +45 7547 0600 • Fax +45 7547 0611
 vc@valcontrols.com • www.valcontrols.com

Copyright © 2007 Val Controls A/S All Rights Reserved

DESCRIPTION Electrical connections – Position Transmitter Foundation Fieldbus/Profibus		
DESIGN DATE 28-09-2009	DESIGNED BY CT	
REVISION DATE 28-09-2009	REVISION 1	DRAWING NO. DS5-IE-002

8 7 6 5 4 3 2 1